



28

Lesson learned

Fault Location

Carlos Fortunato received his Degree in Electrical and Power Systems Engineering and his M. Sc from the Institute of Engineering, Lisbon, Portugal. His experience in Protection and Automation in electrical networks has been developed in the Portuguese electrical company EDP Energias de Portugal. Now, he is a project manager of the Protection and Automation Systems in EDP Distribuição, which involves design and advanced technology development and analysis. He was involved with many R&D activities in the area of Substation Control Automation and Power System Protection. His present research interests are specifically in the wireless systems in the localization of faults in the energy distribution network.

by C Fortunato and M. Santos, EDP – Energias de Portugal, Portugal, A. Casaca and A. Grillo, INESC-ID/ INOV/ IST, Portugal

Fault Location in an Electrical Energy Distribution Infrastructure with a Wireless Sensor Network


This article presents a detailed analysis of the applicability of wireless systems in the localization of faults in the energy distribution network. The hardware and software architectures of the envisaged sensor solution will also be described and finally, the integration of this system into Smart Grids will be discussed in terms of automatic fault analysis. A pilot system has been tested in a subset of the Portuguese energy distribution infrastructure operated by EDP Energias de Portugal. It presents a new approach to a fault locator system for the power network. **The purpose is to obtain faster and more reliable information about the disruptions in the power distribution network and their location. Furthermore, the wireless sensors allow remote detection of medium and low voltage (MV/LV) power transformer hotspots in order to identify emerging malfunction as well as detection of intrusion in the MV/LV power transformers.**

Nowadays, the electrical energy distribution is considered a critical infrastructure in industrially developed societies and its protection regarding safety and security threats is being more and more used.

The fact that this infrastructure is geographically spread across huge areas brings difficult technological challenges for the real-time prevention, detection and precise localization of anomalies.

The protection and localization of faults in the electrical energy distribution is a key task for any operator of such an infrastructure. Securing the main infrastructure components through the deployment of secure wireless sensor networks (WSN) providing remote monitoring and alarm capabilities

1 MV/LV electricity distribution infrastructure

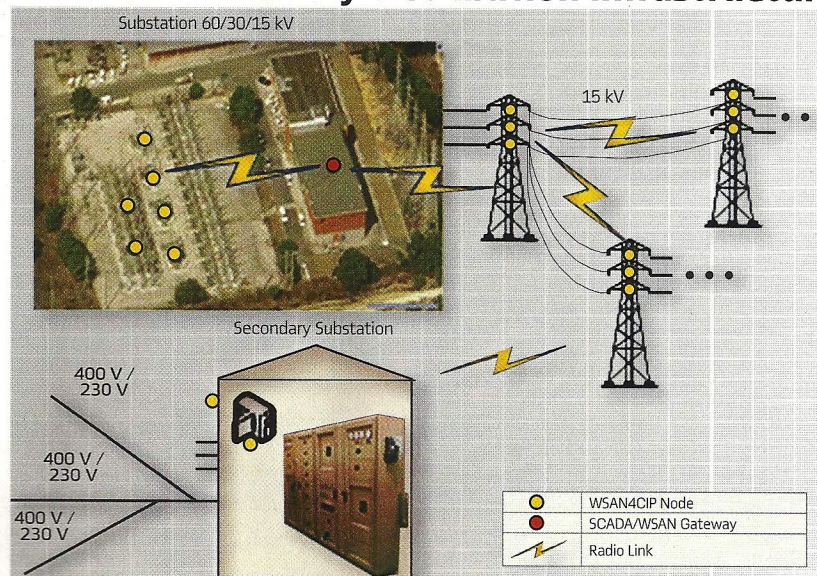



José Miguel Santos received his Degree in Electrical Engineering from Universidade do Porto and an MBA by EGP-UPBS. Previously a Head of Department, he is Associate Director for Automation and Telecontrol in EDP Distribuição. He has been involved in an EDP Corporate Program for the Improvement of the Quality of Power Supply. He is the author and co-author of several papers related to protection, automation and telecommunication.

Augusto Casaca received his Degree in El. Engineering from the Instituto Superior Técnico (IST), Portugal, his M.Sc. in Digital Electronics from UMIST, UK, and his Ph.D. in Computer Science from the University of Manchester, UK. He is Full Professor at IST and Leader of the Action Line on "Communications & Mobility Networks" at INESC-ID. He has been involved in many standardization and R&D activities, and has published a significant number of scientific papers. Antonio was Chairman of IFIP Tech. Committee 6 from 1998 to 2004 and is a Senior Member of IEEE.

specifically in the detection of the fault location is an attractive option for achieving this goal.

This work considers the planned architecture and high-level implementation solutions for the WSN system, including a description of the protected equipment and the hardware and software architecture to be used to detect anomalies. For their detection, the proposed approach in the case of the Medium Voltage (MV) overhead lines is based on the analysis of the increased current.

A current transformer is used to measure its value and to drive a parasitic power source for the wireless sensor, eliminating the need for batteries and at the same time posing no power constraints on the wireless protocols. The sensors will be located in close relation with each tower and each of them monitors one power line.

We also used this wireless communication link to upload a video/image of the MV/LV power transformer of the network. At the same time an infrared thermo sensor attached to the camera sweeps the power transformer critical elements (such as the main switch board) for hotspots. The detection of a hotspot will trigger an alarm into the network.

This feature improves the remote MV/LV power transformer physical security.

Connected to this interface there will be also a switched on by movement camera to show the ac-

cess to the equipment by intruders. This methodology will:

- Improve the quality of the service
- Increase the electrical system reliability
- Maximize the operational efficiency

The wireless technology assures a cost-effective solution to the upgrade of the existing asset base.

Fault Locator System

The fault detection systems are important tools for the improvement of the Service Continuity in an electrical network. They allow the reduction of the time lost in the search of defects and therefore, in the total time of the network break.

In addition to the benefits associated with the reduction of the energy interruption periods for the electrical companies and their clients, these systems have several virtues, enabling the reduction of the operation costs, the identification of the problematic network zones and the avoidance of the equipment deterioration related to the network reconnection over permanent defects during the traditional process of fault localization.

There are several methodologies for the detection and localization of faults used by the Electrical Companies:


- From systems based on the implementation of Fault Locator in the distribution networks,
- To the adoption of analytic methods supported by the Super-

The proposed approach in the case of the Medium Voltage (MV) overhead lines is based on the analysis of the increased current.


vision Control And Data Acquisition (SCADA) systems

By using analytic methods we can detect faults, through wave transmission, the high frequency components of the currents and tensions and the fundamental frequency of the currents and tensions, measured in the line terminals (also called Impedance Based Methods).

2 The prototype of the MV current sensor

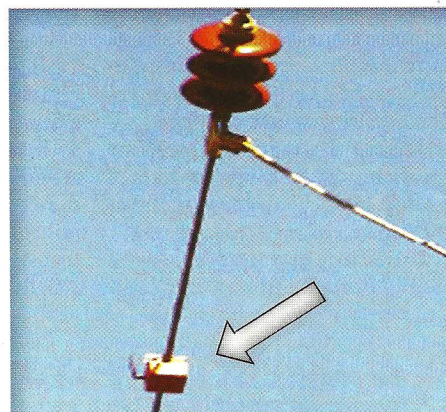

3 Concept of the fault detection and identification system

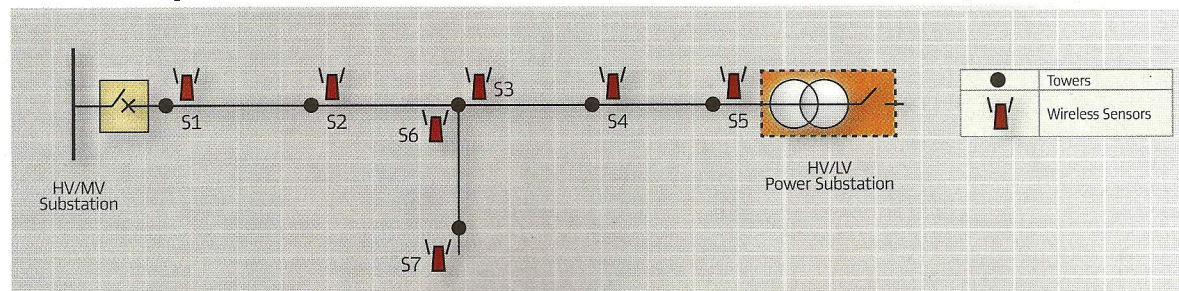

by C Fortunato and M. Santos, EDP – Energias de Portugal, Portugal, A. Casaca and A. Grillo, INESC-ID/ INOV/ IST, Portugal

The video streaming scenario is the most demanding for sensor network resources.

The Impedance Based Methods, consisting in the lines' impedance calculation in their terminations and in the estimation of the distance to the defects are, due to the easiness of implementation, the most adopted ones by the Electrical Companies. These methods can use the measurements of one of the lines' terminations, or the measurements of the two lines' terminations.

The impedance based methods have a precision of 2 to 3% of the total length of the line.

The precision of this method is influenced by several factors, including the combined effect of the charge current and the resistance of the defect (reactance effect), the imprecision in the identification of the type of defect (phases in fault) and the uncertainty about the parameters of the lines, particularly the homopolar impedance.

Nowadays, MV protection units usually have the function of fault

locator incorporated, which is a well established function for transmission networks.

However, distribution networks have some differences that must be taken into consideration.

The main factor is that distribution networks are radial and constituted by many branches, which may have different impedances. In that way, it is not possible to use this information as it is commonly used in higher voltage levels.

In High Voltage (HV) networks each line has a protection unit capable of comparing impedances of the line and fault and transmitting the fault's location data.

However, in MV networks that is not possible because, despite being radial, there are many ramifications with different electrical characteristics.

An option is to use the wireless sensors to communicate from the local network to the SCADA system, which processes the signals sent by the sensors, allowing the operator to know the location of the fault. For example, a sudden variation of current measurements is usually considered a fault indication.

If, for a pair of sensor nodes that are adjacent in the same branch of the electricity distribution network, only one of them is able to measure that sudden variation, then there is a high probability that the fault is lo-

cated precisely between those sensor nodes.

This solution can be easily implemented with reduced costs.

Case Study

The proposed approach was tested through a case study of a distribution line and MV/LV Power Transformer. This case study was made within the FP7 European project WSN4CIP, which uses a WSN technology.

Here, the faults can be located quickly, reducing the time of a power outage. A more complete view of the whole system deployed for fault location can be generically observed in Figure 1.

A picture of the MV Current Sensor prototype developed by INOV with the contribution of EDP can be seen in Figure 2.

Basically there are sensors at the substation to monitor the status of the trip coils, the temperature of the transformers and the neutral resistor and at the power lines to monitor the current and detect and locate the faults. In the MV/LV power transformers placed in the secondary substation, there are also video sensors to detect intrusions and hotspots.

The WSN interacts with the SCADA system to allow a centralized monitoring and control of the protection system. A gateway node acts as a sink node to receive

4 Screens of the SCADA system

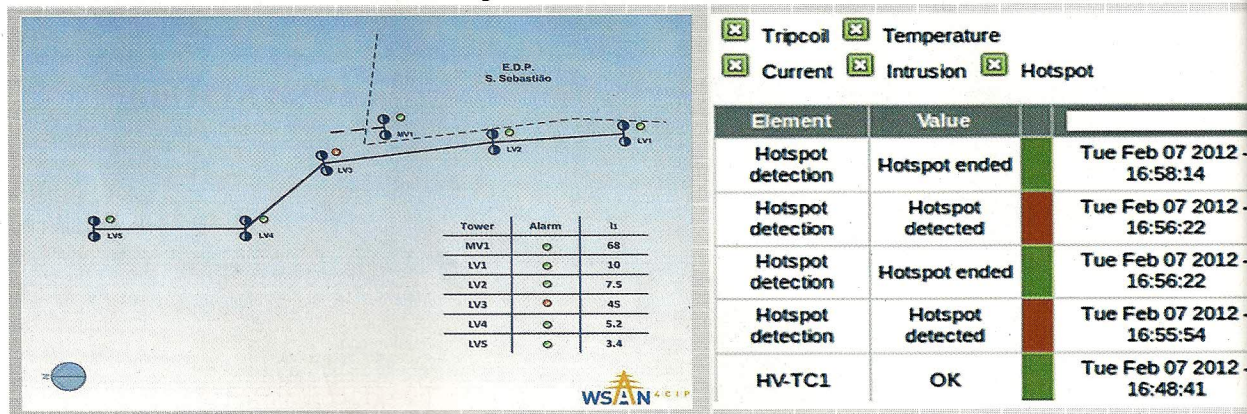


Figure 4 shows the human machine interface of the system.



Antonio Grillo received his Information Technology Engineering degree, his M.Sc. degree in Electrical and Computer Engineering, and his Ph.D. in Electrical and Computer Engineering from the Instituto Superior Técnico, Portugal. He is Assistant Professor at Instituto Superior Técnico, where he lectures subjects related with computer and sensor networks. In 1995 he joined INESC, Lisboa, where he is currently a senior researcher. His current research areas are Wireless and Mobile Networks. From 1996 until now he has been working in several European research projects (the IST project, UbiSec & Sens and FP7-WSAN4CIP).

Nowadays, the electrical energy distribution is considered a critical infrastructure in industrially developed societies and its protection regarding safety and security is being used more and more.

data from the sensors and provides the interface to the Supervision Station.

There is usually a line-of-sight between the towers with the indicated facilities installed. We used a combination of software and easily installed line mounted equipment that monitors the distribution network. The current sensors were installed on the three phases of the towers, which communicate between them via radio (Wi-Fi).

The sensors provide line current data, and are "self powered" via the magnetic field on the line, or alternatively by the on-board backup battery when an outage occurs. The sensor board is remotely configurable; therefore it can be used as a fault/event detector load monitor with user configurable thresholds. All data may be accessed via a secure web-controller. This allows the user to view all available currents on the network.

The fault locator system operation is shown in Figure 3. It resumes the integration of a Wi-Fi intelligent fault locator system for the early detection of abnormalities in the network branches. The system is based on the use of several fault detectors (current sensors) in the network towers, which transmit information among them. This allows immediate user notification of the fault's location.

Considering the network in Figure 3, if a fault occurred between the S6 and S7, as an example, it would be detected by S7 and S6 and the information transmitted through Wi-Fi to S6, S2 and finally to S1 and from there to the gateway to the SCADA system. After collected by the rear-end processing system, the fault location can be identified and displayed in the Human Machine Interface of SCADA system (Figure 4).

A gateway node acts as a sink node to receive data from sensors and provides the interface Supervision Station.

The video streaming scenario is the most demanding in terms of sensor network resources. Video is streamed multihop from MV/LV power transformer to the SCADA supervision station when a passive infrared motion detector detects an intrusion.

The human machine interface of the system is shown in Figure 4. With those outputs it is possible to

see the status of the network of the sensors, the alarms, the currents and the images of intrusion and hotspots.

A database of all faults is created in the SCADA system. This way it is possible to:

- Analyze the location and type of faults over time,

- Provide valuable information for intervention in the network's maintenance

In the WSAN4CIP project we focused onto improving the dependability of the substation components, MV and LV power lines, and MV/LV power transformers in the secondary substations. We defined solutions for the remote active monitoring of:

- Substation circuit breaker trip coil status

- Temperature of the substation power transformer oil, substation neutral reactance oil and substation neutral resistor coil box

- MV and LV power line current activity


- MV/LV power transformer hotspot detection

- Human activity in the secondary substation through the use of movement detectors and video cameras

All the monitored parameters and images are visualized at the SCADA system, through a special-purpose graphical user interface. The communication between the sensors is done through the IEEE 802.11g protocol (Wi-Fi).

The generic configuration of the system is shown in Figure 5. The WSAN is integrated with the SCADA system by means of a SCADA/

5 Configuration of the WSAN based system

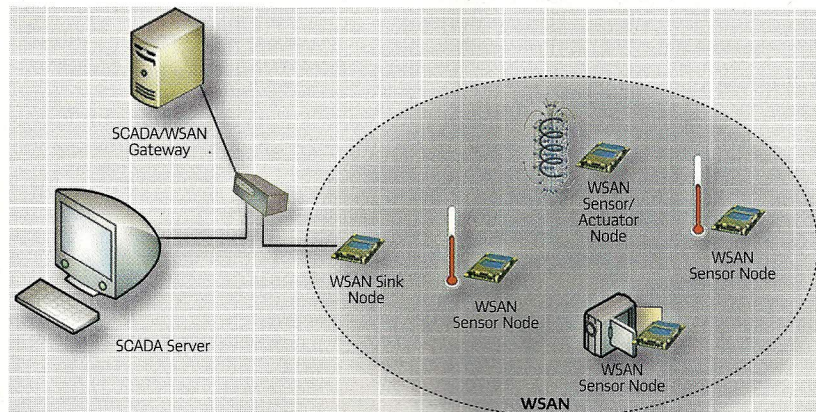

by C Fortunato and M. Santos, EDP – Energias de Portugal, Portugal, A. Casaca and A. Grillo, INESC-ID/ INOV/ IST, Portugal

table 1 Temperature and current precision evaluation

Application	Number of Trials	Average Error	Maximum Error	Standard Deviation
Power Line Current	20	4.60%	10.90%	3.10%

table 2 Event precision evaluation

Application	Number of Trials	Measurement Errors	Success Rate
Intrusion Detection	11	0	Hotspot Detection
Hotspot Detection	10	0	Hotspot Detection

WSAN Gateway, in order to provide a unified power distribution infrastructure interface to the human operators.

The power-line sensor nodes were developed based on a Silex SX-560 core. The PCB designed at INOV includes a common voltage converter able to generate 3.3V DC to feed the Silex and 5V DC to feed the USB interface (considered a part of the Sensor Interface Unit) based on an input of 6-20 V DC. The Energy Unit in the board is able to harvest energy from the MV power-line, assuring the autonomy of the sensor nodes for a long time period, without the need for maintenance.

The software modules of the WSAN node are depicted in Figure 6. The selected Operating System is Linux.

The main software modules of a generic WSAN4CIP node are the following:

■ **WSAN Sensor /Actuator Application Logic:** Application logic of the WSAN node, that manages sensors, actuators and communications

■ **Dependable Protocol Stack:** The Routing and Transport protocols. The transport layer consists of a secured version of the Distributed Transport for Sensor Networks (DTSN) while routing consists of a secure version of the Routing Pro-

For the current tests, extra current was externally injected into the power lines by the EDP technicians.

tolocol for Low power and Lossy Networks (RPL)

■ **Sensor/Actuator Device Driver:** Software that provides access to each type of sensor/actuator

■ **Management Information Base (MIB):** Configuration parameters of the WSAN nodes

Experimental results

Tests were conducted in the WSAN4CIP trial network in order to assess the performance of the supported services and the compliance with the requirements provided by EDP.

For the current measurement tests, extra current was externally injected into the power lines by the EDP technicians and the sensor reports were confronted against the known current injection values.

For the intrusion and hotspot detection tests, the respective situations were simulated by the EDP and INOV team. The tests entailed the transmission of images from the MV/LV power transformer to the primary substation.

For the hotspot detection, a soldering iron was placed in front of the camera, while for intrusion detection, a member of the EDP team simulated intrusions in the secondary substation.

The measurement precision test results are listed in Table 1 and Table 2.

For the power line current measurements, the average error was 4.58% with peaks of 10.83%. This precision, although we are at a prototype level, is enough to detect breakdown spots in the power-lines as well as to provide coarse reports about the distribution of

6 Software architecture of the sensor node

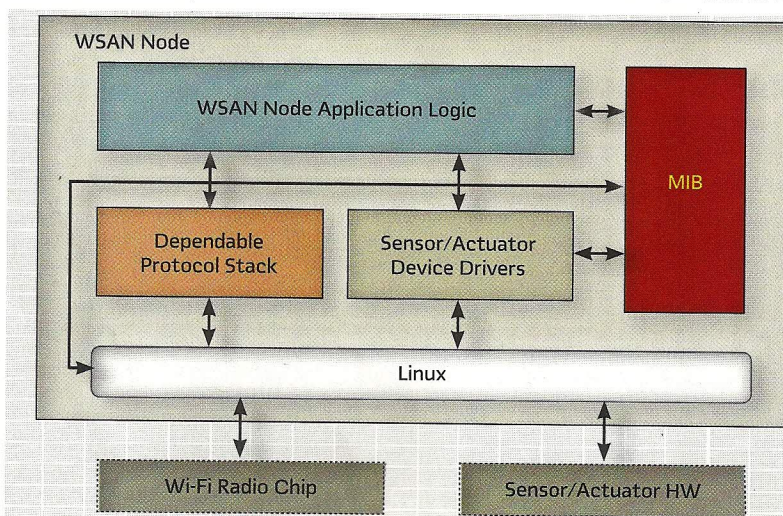


Figure 6 depicts the software modules of the WSAN node. The selected Operating System is Linux.

table 3 Delay evaluation

Application	Average Delay	Standard Deviation	Delay Bound Requirement
Power Line Current Measurement (1 hop)	21.50 ms	5.10 ms	< 10 s
Power Line Current Measurement (5 hops)	120.20 ms	10.0 ms	< 10 s
Intrusion Detection	2.10 s	1.10 s	< 10 s
Hotspot Detection	2.20 s	0.40 s	< 10 s

current consumption within the EDP network.

The power-line sensing delay was measured at two different nodes, located at 1 hop and 5 hops from the SCADA/WSAN Gateway. At the 5 hops, the delay was still a small fraction of the allowed maximum.

Intrusion and hotspot detection figures are relative to the sensor node located at the secondary substation, which was positioned at approximately 7 hops from the SCADA/WSAN Gateway. Regarding packet losses, no packets were lost during these scalar sensor tests.

The results of the video performance evaluation tests are listed in Table 4. Results are presented for two transport protocols:

- DTSN
- UDP

In both cases the test are running over the IP protocol. UDP is currently the de facto transport protocol for delay-sensitive multimedia data, although it provides no reliability support, while DTSN provides optimized retransmission-based reliability.

As can be seen, both UDP and DTSN present similar delay and jitter performance, being able to comply with the requirements defined by EDP. DTSN achieves lower frame losses due to its error recovery mechanism, while achieving slightly lower delay. Although neither of the tested transport protocols is able to provide the required channel capacity of 768 Kbit/s, both are able to support the required resolution at a frame rate that is even higher than the one defined therein. The difference towards the required channel capacity is also not too significant, being respectively 11.5% and 12.5% for UDP and DTSN.

Conclusions

The analysis and application of the Fault Location method for distribution lines and MV/LV power transformers has been presented. In the proposed approach, the acquired current signals, hotspots images signals and intrusion detection images are transmitted to the SCADA System.

The signals acquired from the electrical grid are processed in the server to identify the kind and lo-

The WSAN4CIP project fits in the Smart Grid EDP project and it is a proof of concept and a step forward in fault and pre-fault detection.

cation of fault. To identify the faulty operation it will be used as a program to detect the towers in which the faults exist. In order to confirm the proposed approach, several test results for different situations have been presented.

This article has presented the planned architecture and high-level implementation solutions for the WSN system, including a description of the protected equipment, the hardware and software architecture.

We can conclude that it is possible pre-fault detection, which will prevent some damages in major equipment, minimizing the impact on clients; the faults can be located quickly, reducing the time of a power outage.

The WSAN4CIP project fits in the Smart Grid EDP project and it is a proof of concept and a step forward in fault and pre-fault detection.

This Project can also be included in the Distribution Automation (DA), which is a key component of the smart grid.

The sensors, on the other hand, could transmit the signals of fault location in order to correct it via the switch in MV mixed networks. ■

Acknowledgment:

This research received funding from the European Community's 7th Framework Program under grant agreement no. 225186.

Consortium:

Eurescom, IHP Microelectronics, NEC Europe, INOV, EDP Energias de Portugal, Budapest University of Technology and Economics, INRIA, Lulea University of Technology, Sirrix, Tecnatom, University of Malaga and FWA.

table 4 Video streaming evaluation

Transport Protocol	Parameter	Average	Standard Deviation	Requirement
UDP	Delay	183.00 ms	35.00 ms	< 10.00 s
	Jitter	10.00 ms	4.00 ms	< 200.00 ms
	Throughput	233.00 Kbit/s	---	---
	Video frames lost	0.83 %	2.00 %	< 2.00 %
	Channel capacity	680.00 Kbit/s	191.00 Kbit/s	768.00 Kbit/s
DTSN	Delay	176.00 ms	37 ms	< 10.00 s
	Jitter	11.00 ms	5 ms	< 200.00 ms
	Throughput	243.00 Kbit/s	---	---
	Video frames lost	0.00 %	0.00 %	< .002%
	Channel capacity	672.00 Kbit/s	188.00 Kbit/s	768.00 Kbit/s